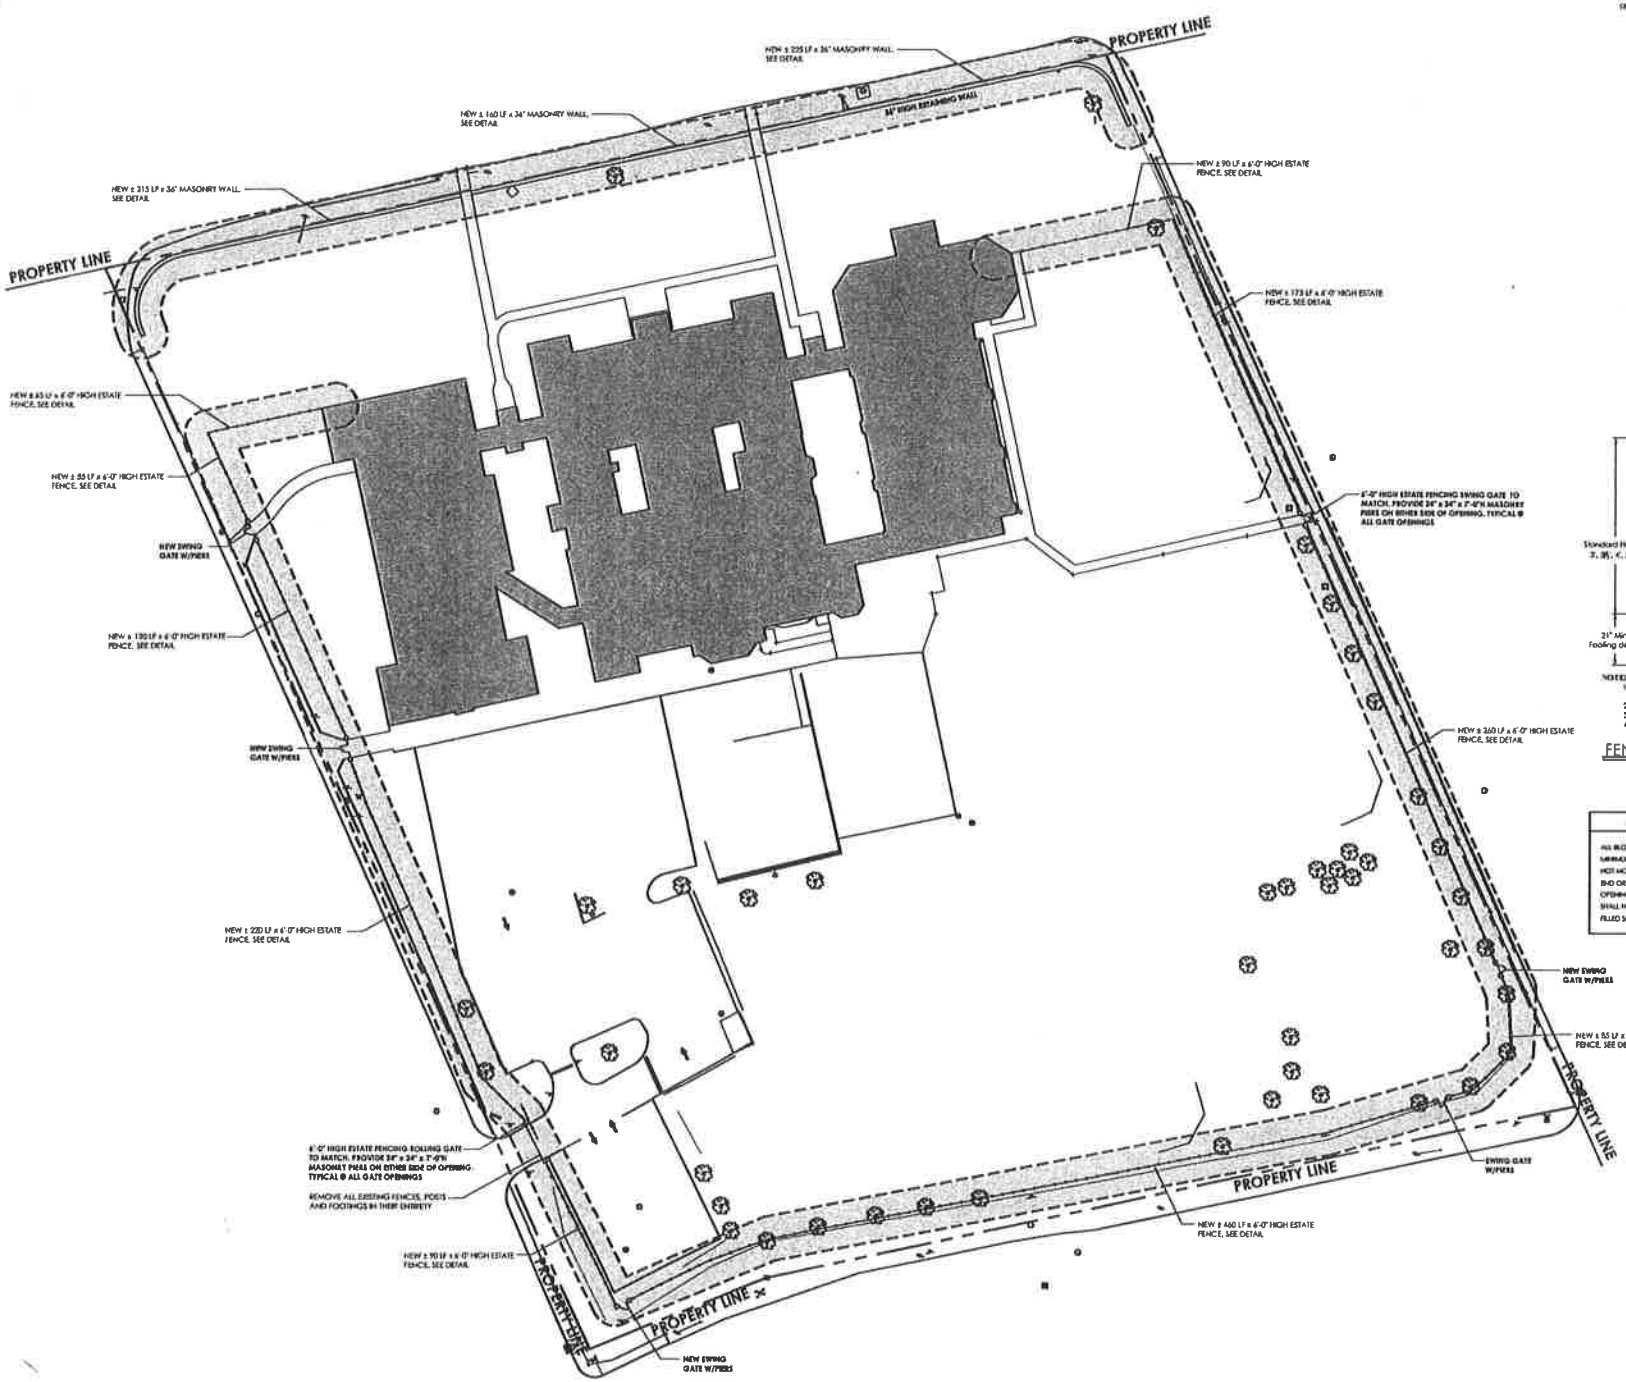

OVERALL SITE PLAN

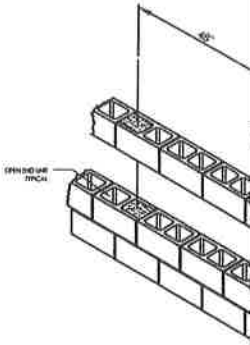

MASONRY WALL REINFORCEMEN

WALL TIE DETAILS



NOTES:
1.) Post size depends on fence height and wind loads. See ECESLOH Plan post sizing chart.
2.) Panels also available for 8' on center post spacing
3.) Additional heights available on request
4.) Fourth rail optional.

FENCING DETAIL

SCALE: 1/2"

MASONRY WALL REINFORCING NOTE

ALL BLOCK WALLS ARE TO BE REINFORCED AS FOLLOWS:
MINIMUM VERTICAL REINFORCEMENT SHALL CONSIST OF (1) ONE NO. 4 BAR SPAC
NOT MORE THAN 48" O.C. ALONG ALL WALLS AND NOT MORE THAN 16" FROM A
END OR CORNER OF A WALL IN ADDITION TO THE VERTICAL BARS SHOWN AROU
OPENINGS AND AT PIERS. ALL CORES CONTAINING VERTICAL REINFORCING
SHALL NOT CONTAIN ANY FORM OF BARRIER INSULATION INSERTS AND SHALL BE
FILLED SOLID WITH 2,000 PSI MASONRY GROUT. SEE DETAIL FOR ADDITIONAL INFO.